



CUSTOMISED ATEX JUNCTION BOXES

The thermosetting GRP TAISBOX-EXU and the aluminium alloy ALUCASE-EXU boxes can be completed with cable glands and terminal blocks, allowing the creation of customised junction boxes, suitable for installation in zones 1-2-21-22 in accordance with the ATEX 2014/34/EC Directive. The configurations customised and certified by a Notified Organism can be made by Palazzoli upon specifications of the customer.

To make the configurations it is necessary to know:

1. Number and type of modular terminal blocks.

The IEC/EN60715 DIN rail inside the box can be complemented with ATEX-compliant and Ex-eb-certified modular terminal blocks. The maximum number of terminals that can be used depends on the physical dimensions of the box, according to the table below, and on the maximum power dissipation.

2. Number, type e positions of the cable glands.

Each box can be drilled on the 4 sides using a max. number of entries that depends on the dimensions of the cable glands and on side area. Cable glands from Palazzoli or any other brand, from M12 to M50, may be used. They must comply with the ATEX Directive and certified with the Ex-e/Ex-ib protection mode. If windowed boxes are used, it is possible to complete them with suitable drilled flanges or blind raised flanges (Table below).

SERIES	CODE OF EMPTY BOX	DIMENSIONS (BxHxD)	DIN GUIDE LENGTH (mm)	MAXIMUM NUMBER OF CABLE GLANDS THAT CAN BE INSTALLED ON EACH SIDE													
				LONG SIDE OF THE BOX (B)							SHORT SIDE OF THE BOX (H)						
				M12	M16	M20	M25	M32	M40	M50	M12	M16	M20	M25	M32	M40	M50
TAISBOX-EXU	532200EX	185x125x125	145	12	8	6	3	2	2	-	6	4	3	2	1	1	-
	532201EX	190x185x125	160	12	8	6	3	2	2	-	12	8	6	3	2	2	-
	532202EX	250x185x125	220	16	14	12	5	4	3	-	12	8	6	3	2	2	-
	532203EX	290x185x125	260	20	16	14	6	5	4	-	12	8	6	3	2	2	-
	532204EX	380x185x125	333	26	24	22	9	7	6	-	12	8	6	3	2	2	-
	532035EX	92x92x68	59	2	1	1	-	-	-	-	2	1	1	-	-	-	-
	532045EX	125x92x68	92	4	3	3	2	-	-	-	2	1	1	-	-	-	-
	532055EX	185x92x68	142	6	4	4	2	-	-	-	2	1	1	-	-	-	-
	532116EX	125x125x100	86	7	4	3	2	1	1	-	6	4	3	2	1	1	-
	532117EX	185x125x100	100	12	8	6	3	2	2	1	6	4	3	2	1	1	-
	532118EX	250x125x100	175	16	14	12	6	4	3	-	6	4	3	2	1	1	-
	532005EX	92x92x100	59	2	1	1	-	-	-	-	2	1	1	-	-	-	-
	532006EX	125x92x100	92	4	3	3	2	-	-	-	2	1	1	-	-	-	-
	532015EX	185x92x100	142	6	4	4	2	-	-	-	2	1	1	-	-	-	-
	532016EX	125x125x125	86	7	5	4	2	1	-	-	6	5	4	2	1	-	-
	532017EX	185x125x125	100	12	7	6	4	3	-	-	6	5	4	2	1	-	-
	532018EX	250x125x125	175	16	10	8	5	4	-	-	6	5	4	2	1	-	-
ALUCASE-EXU	511910EX	92x92x77	69	3	2	2	1	-	-	-	3	2	2	1	-	-	-
	511913EX	125x125x113	100	8	5	4	2	2	-	-	8	5	4	2	2	-	-
	150021EX	155x155x73	122	10	6	5	3	1	-	-	10	6	5	3	1	-	-
	511920EX	185x185x145	160	18	12	10	8	4	3	2	18	12	10	8	4	3	2
	511921EX	252x185x145	200	24	16	14	10	5	4	3	18	12	10	8	4	3	2
	511911EX	125x92x77	100	3	3	2	-	-	-	-	-	-	-	-	-	-	-
	511912EX	185x92x77	150	6	5	4	-	-	-	-	-	-	-	-	-	-	-
	511917EX	252x125x113	200	16	14	6	5	4	-	-	2	1	-	-	-	-	-
	511922EX	220x220x108	190	3	3	2	2	-	-	-	3	3	2	2	-	-	-
	511923EX	252x252x197	210	32	28	18	10	8	6	3	15	8	6	6	2	2	1

3. Maximum utilisation current for each terminal.

By specifying this detail it is possible to calculate more precisely the maximum power dissipation and use optimised boxes with more compact dimensions. If this detail cannot be supplied, the maximum rated current should be considered and larger boxes will have to be used.

4. Ambient temperature

The boxes in Palazzoli Thermosetting GRP of the TAISBOX-EXU series and the boxes in aluminium alloy of the ALUCASE-EXU series can be used at different temperatures. The complete tables are on page 250 for the TAISBOX-EXU series and page 252 for the ALUCASE-EXU series.

Also in this case, by carefully choosing the temperature range, it is possible to use optimised boxes with more compact dimensions.



REQUEST FORM FOR CUSTOMISED ATEX JUNCTION BOXES

DATA REQUIRED

CODE OF EMPTY PALAZZOLI BOX: _____

QUANTITY TO BE PRODUCED: _____

MAX AMBIENT TEMPERATURE (°C): _____

BRAND OF TERMINAL: _____

(if not expressly indicated, the terminals are the responsibility of Palazzoli)

INTERNAL COMPOSITION	TERMINAL RATED CROSS-SECTION (mm ²)						
	2.5	4	6	10	16	25	35
NUMBER OF TERMINALS							
CURRENT PER TERMINAL (A)							

Indicate in the table the number of terminals and the current required for each terminal.

CABLE GLAND MATERIAL: Insulating ☐ Brass ☐



EXACT MAKE AND MODEL OF CABLE GLAND: _____

(if not expressly indicated, the cable glands are the responsibility of Palazzoli)

EXTERNAL COMPOSITION	CABLE GLAND THREAD						
	M12	M16	M20	M25	M32	M40	M50
NUMBER OF CABLE GLANDS							

Indicate in the table the number of cable glands and their positions on the four sides of the box as in the example below.

Example:

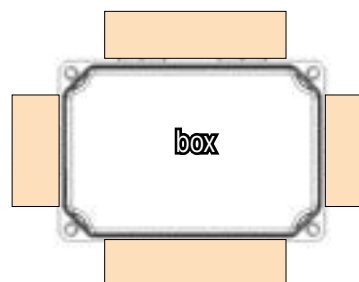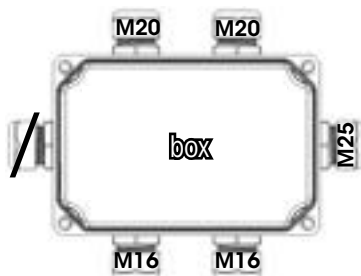

The form must be sent to vendite@palazzoli.it